




ITEM	NO. REQ'D.	DESCRIPTION
1	1	1" SERVICE CONNECTION PER STANDARD DRAWING W1090.
2	1	1" TYPE "K" SOFT COPPER TUBING OR APPROVED PEX-A, ONE PIECE (VARIABLE LENGTH).
3	1	ANGLE BALL METER VALVES (SIZES SHALL MATCH METER SIZE OUTLETS).
4	1	METER (FURNISHED BY DISTRICT AND INSTALLED BY CONTRACTOR).
5	1	J&R CONCRETE 5 1/2 WITH POLYMER METER BOX (28"L x 17-1/4"W) AND POLYMER CONCRETE COVER WITH TOUCH READ PORT OR APPROVED EQUAL.
6	1	1" STANDARD WEIGHT BRASS NIPPLE (12" LONG).
7	1	1" BRASS COUPLING.
8	1	1" BRASS "U" BRANCH.
9	1	1" McDONALD 711-4JM 54, OR APPROVED EQUAL, DOUBLE CHECK VALVE.
10	1	1" LOCKABLE BALL VALVE.

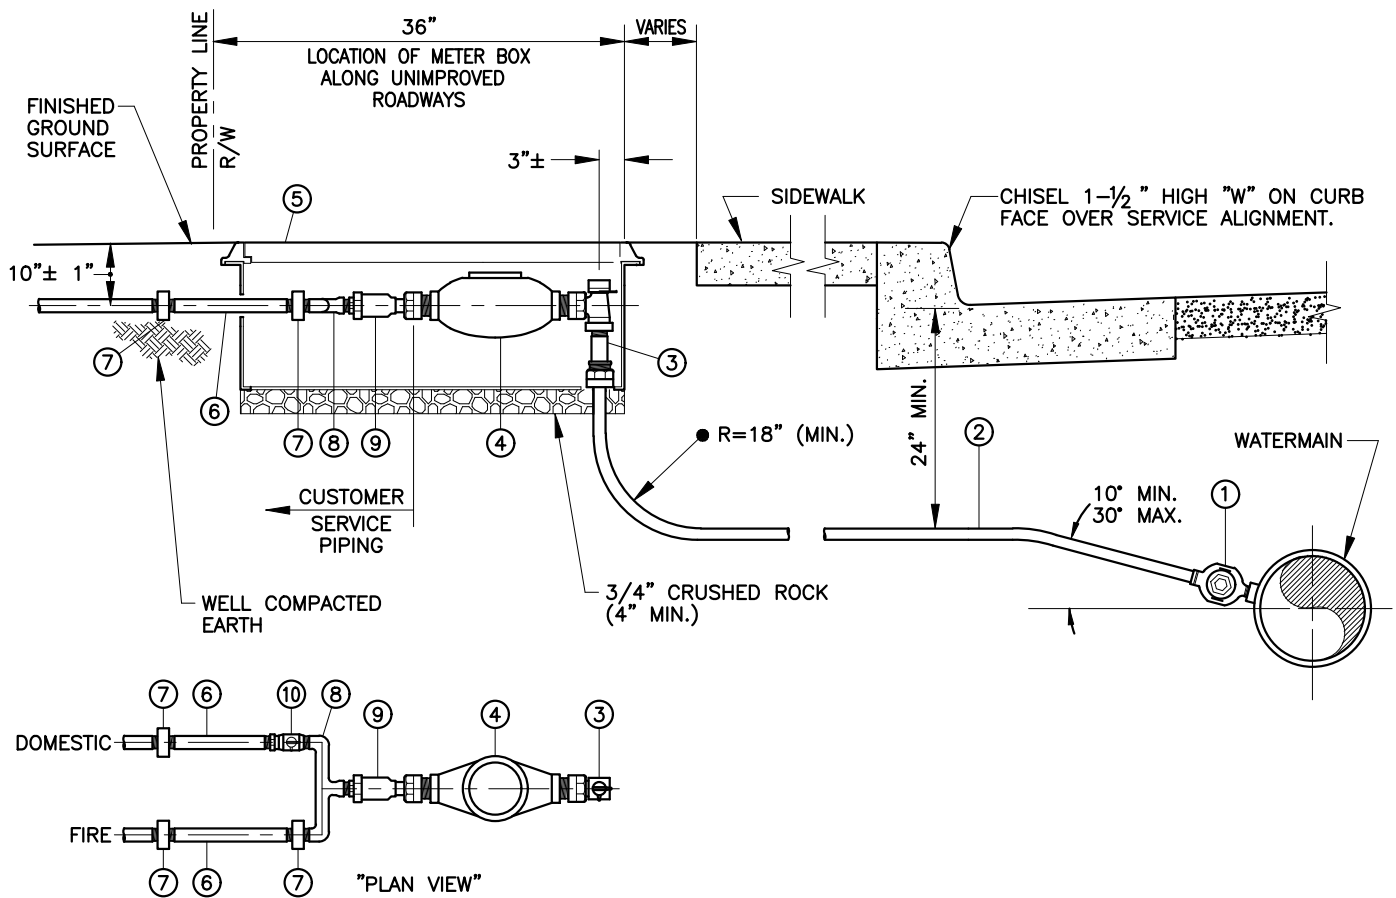

APPROVED:

Jaclyn Makarzec
DIRECTOR OF ENGINEERING
DATE: AUGUST 2025

RUBIDOUX COMMUNITY SERVICES DISTRICT
3/4" OR 1"

TYPICAL SERVICE INSTALLATION

STANDARD DRAWING

W1100
SHEET 1 OF 2