



POTABLE WATER PRODUCTION REPORT (ACRE-FEET)

2024/2025 Calendar Years

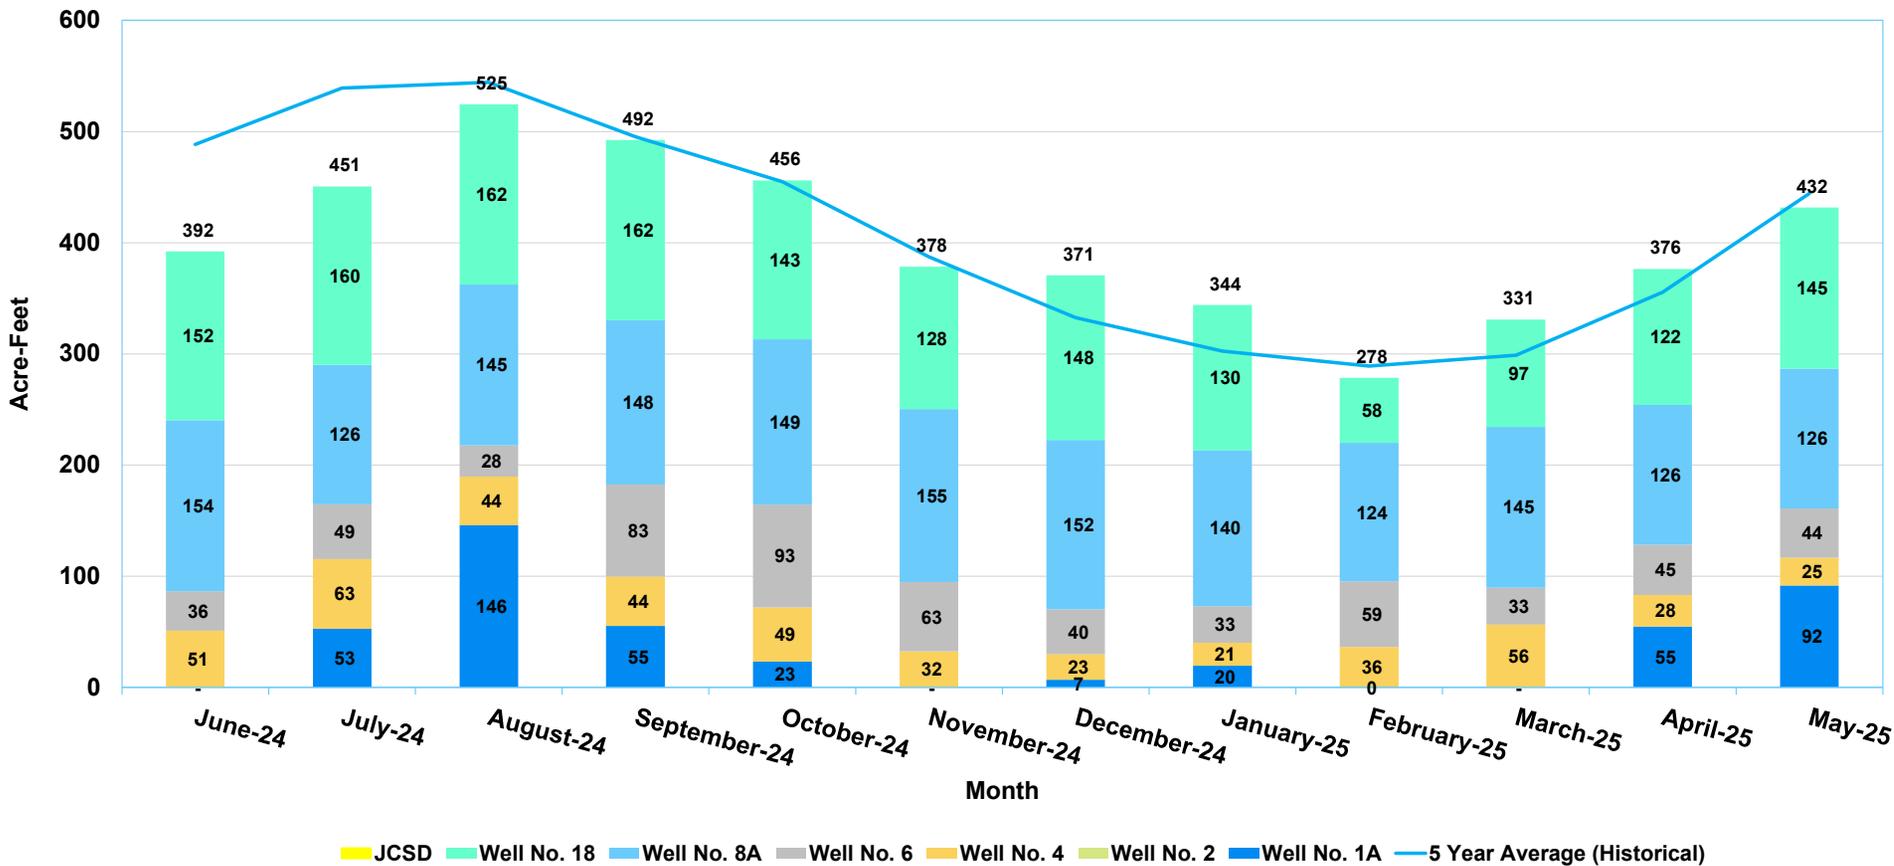

Potable Water & Wastewater Comparison May 2025

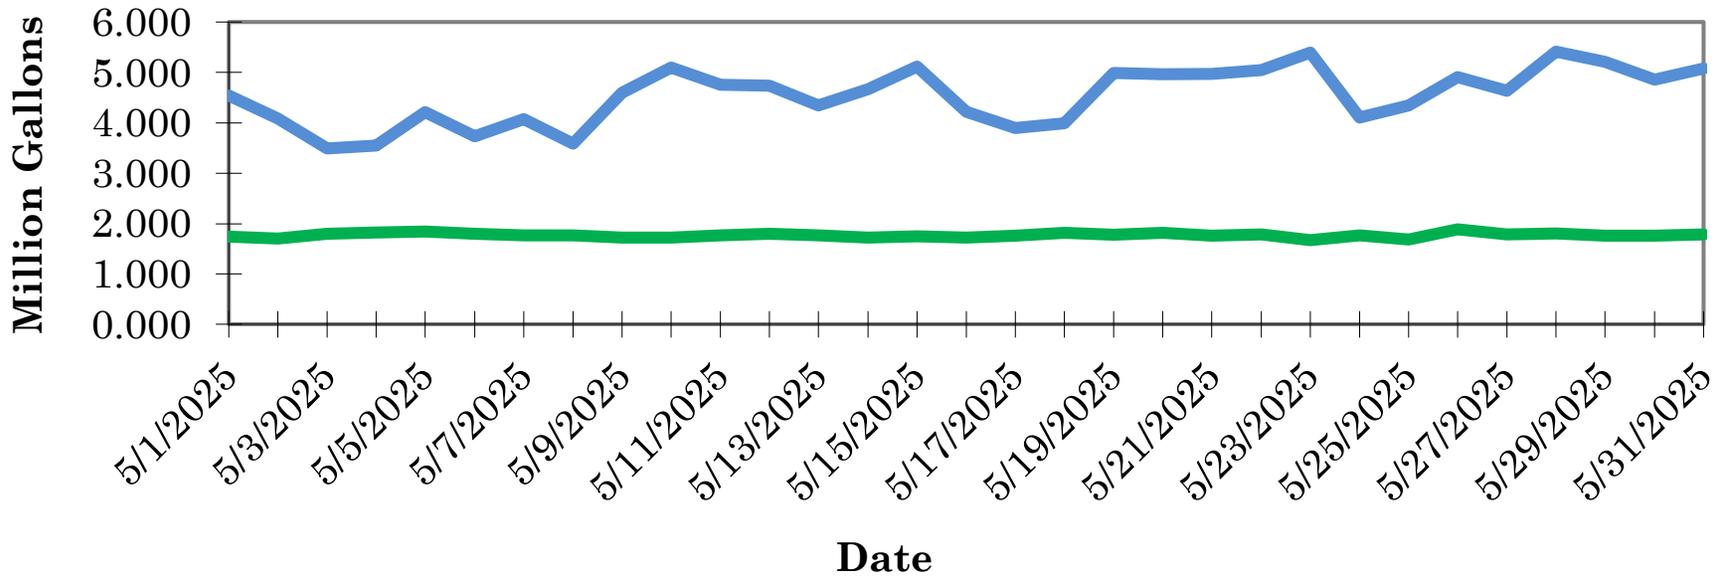


— Potable Water Prod. — Wastewater Prod

RUBIDOUX COMMUNITY SERVICES DISTRICT

Reservoir Capacity Report

CAPACITY	ATKINSON SYSTEM		HUNTER SYSTEM		WATER AVAILABLE (Gallons)*	PERCENTAGE OF TOTAL CAPACITY
	2,000,000	3,000,000	425,000	1,000,000		
DATE	ATKINSON	WATSON	HUNTER 1	PERRONE		
5/1/2025	73.0	64.4	85.6	80.8	4,565,616	71.1%
5/2/2025	75.3	66.7	87.3	80.8	4,685,032	72.9%
5/3/2025	76.4	66.7	89.8	80.8	4,719,059	73.4%
5/4/2025	78.6	68.8	84.3	80.2	4,797,473	74.7%
5/5/2025	76.1	66.7	82.3	80.7	4,680,049	72.8%
5/6/2025	72.5	65.7	80.7	80.0	4,561,981	71.0%
5/7/2025	74.9	66.0	79.1	77.8	4,591,608	71.5%
5/8/2025	74.3	65.2	82.9	81.0	4,603,171	71.6%
5/9/2025	73.4	64.8	79.1	77.8	4,525,705	70.4%
5/10/2025	71.0	63.1	78.1	77.2	4,416,463	68.7%
5/11/2025	73.2	64.4	76.7	76.0	4,480,494	69.7%
5/12/2025	71.1	62.9	72.9	72.1	4,340,004	67.5%
5/13/2025	74.3	66.2	71.3	70.8	4,482,675	69.8%
5/14/2025	71.9	64.6	74.6	73.6	4,426,906	68.9%
5/15/2025	74.0	66.6	74.2	74.1	4,534,856	70.6%
5/16/2025	74.7	67.7	76.8	75.8	4,610,722	71.8%
5/17/2025	74.6	65.6	82.1	80.8	4,617,163	71.9%
5/18/2025	76.3	66.7	78.2	76.5	4,624,489	72.0%
5/19/2025	73.4	64.8	73.6	74.2	4,466,877	69.5%
5/20/2025	71.6	64.2	70.3	70.7	4,362,508	67.9%
5/21/2025	74.4	66.1	69.8	69.4	4,461,741	69.4%
5/22/2025	74.6	67.2	69.0	68.4	4,485,364	69.8%
5/23/2025	71.3	64.3	69.2	67.8	4,327,721	67.4%
5/24/2025	76.4	68.3	70.1	68.5	4,560,133	71.0%
5/25/2025	70.7	63.4	72.6	71.3	4,338,439	67.5%
5/26/2025	71.1	65.3	70.5	70.7	4,387,333	68.3%
5/27/2025	74.3	65.9	67.8	67.6	4,426,958	68.9%
5/28/2025	72.2	65.4	68.7	67.9	4,375,682	68.1%
5/29/2025	74.3	66.0	69.5	69.1	4,451,894	69.3%
5/30/2025	74.4	65.7	69.3	68.7	4,439,584	69.1%
5/31/2025	75.1	67.0	68.1	67.2	4,473,192	69.6%

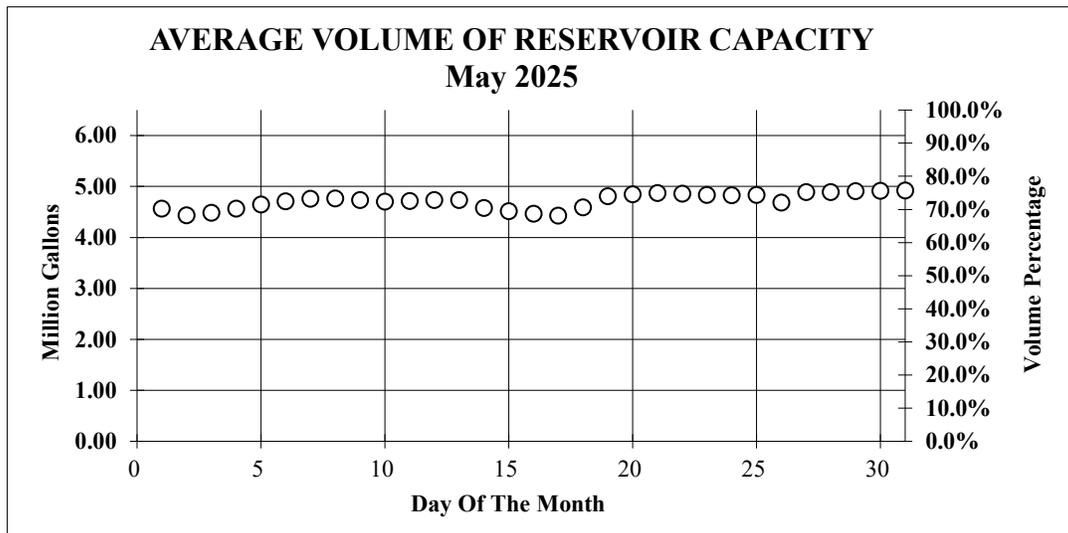

* The total capacity of all District reservoirs is 6,425,000 gallons.



Chemical Deliveries May 2025

- Sodium Bisulfite 25%
 - Delivered to: Thompson Plant
 - Quantity: 2,778 gallons
- Morton NSF Certified White Crystal Salt
 - Delivered to: Smith Plant
 - Quantity: 0
- Sodium Hypochlorite 12.5% (Liquid Chlorine)
 - Delivered to: Thompson Plant, Smith Plant, & Well 8
 - Quantity: 3,600 gallons



Operations

Sewer Vactor Truck

- Purchased March 20, 2025
- Sewer line cleaning
- Cleaning lift stations






Operations

Wet Well Wizards at Lift Station

- Provides aeration and agitation
- Hydrogen sulfide reduction
- FOG emulsification

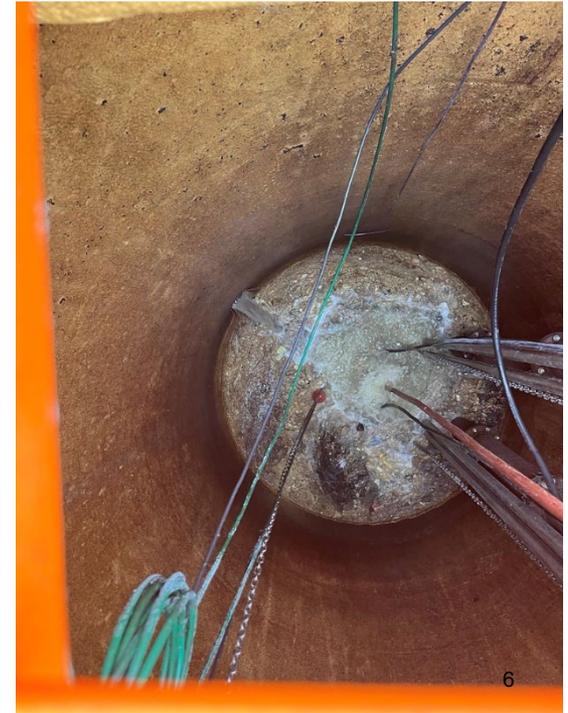



Operations






Operations

Thompson Plant Upgrades

- Mn filter vessel interior coating
- 18" check valve install
- District-wide flushing

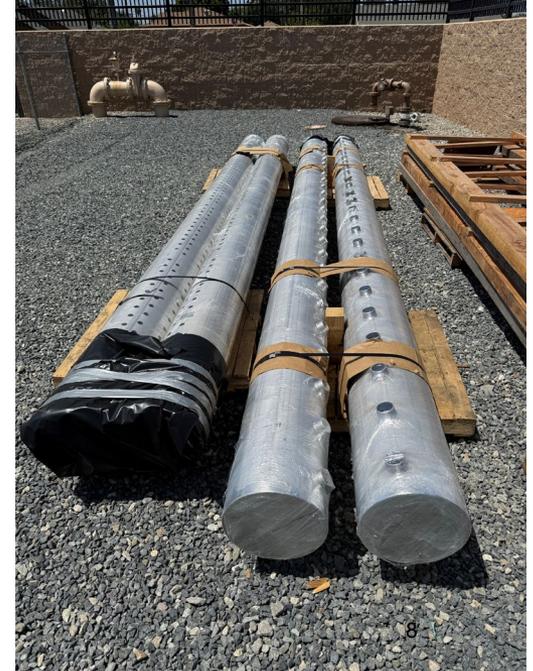



Operations

Loring Ranch Pressure Reducing Valve

- Will lower the pressure from 125 psi to 85 psi





Operations

New Certifications

- Marcos Salas – Collection System Maintenance 2, 4/18/2025
- Jim Ulloa – Certificate of Achievement in Water Supply Technology – San Bernardino Valley College, 5/23/2025
- Eddie Martinez – Associate of Science Degree in Water Supply Technology – San Bernardino Valley College, 5/23/2025

